


Project Name


Sidewalk & Parkway Restoration

General Notes

1. SLOPE SHALL BE AT A MINIMUM OF 1/4" PER FOOT AND NOT EXCEEDING 4:1 (HORIZONTAL:VERTICAL). SIDEWALK WIDTH IS TO BE 5 FEET ALONG COLLECTOR AND MAJOR STREETS, AND 4 FEET ALONG MINOR STREETS.
2. SIDEWALK SHALL BE A MINIMUM OF 6" THICK AT DRIVEWAYS AND 5" THICK ELSEWHERE.
- 3.

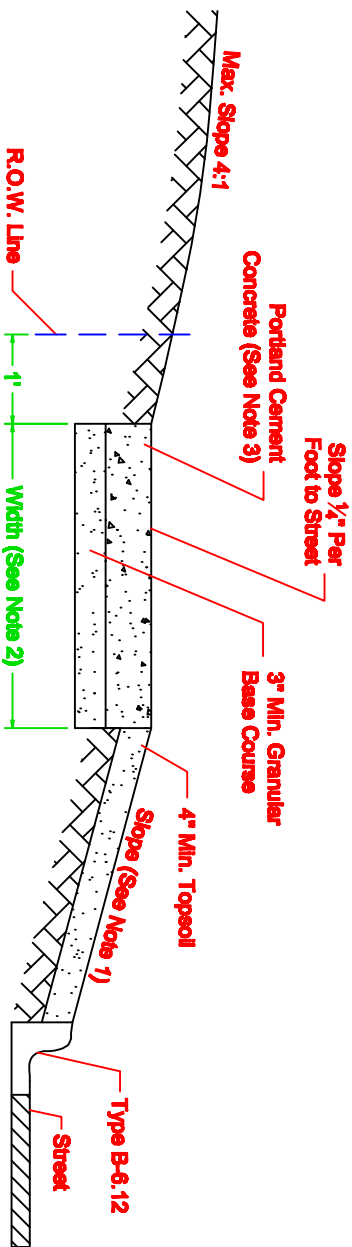

Typical Sidewalk Section in Cut Area

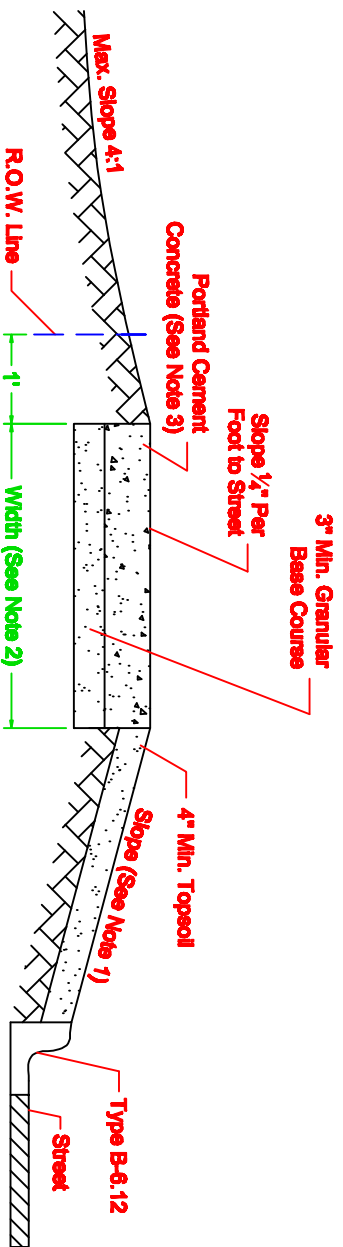

Typical Sidewalk Section in Filled Area

Date

6-3-2008

Address

Village of Burr Ridge  
Engineering Department  
451 Commerce St.  
Burr Ridge, IL 60527