


Project Name
**Steel Casing Pipe
(Typical Detail)**


General Notes

1. USE STEEL CASING PIPE $\frac{1}{4}$ " THICK MIN. TO BE BORED AND JACKED. THE ENTIRE VOID SPACE BETWEEN CARRIER PIPE AND CASING PIPE SHALL BE FILLED AND COMPACTED WITH SAND OR PEA GRAVEL. BOTH ENDS OF CASING PIPE TO BE BRICKED AND MORTARED CLOSED.
2. AUGER PIT TO BE A MINIMUM OF 10' FROM BACK OF CURB. CASING PIPE TO EXTEND 10' MINIMUM BEYOND BACK OF CURB.

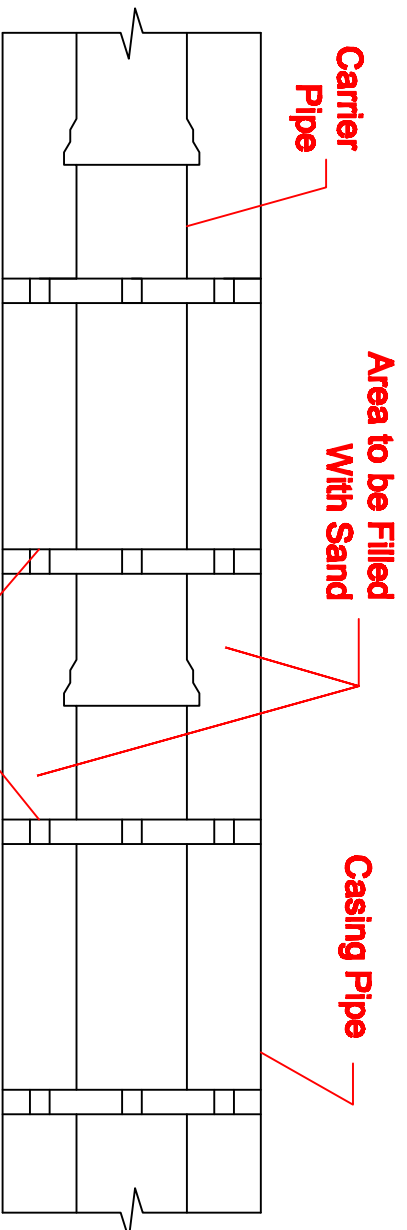

**"Cascade" Brand Stainless
Steel/Nylon Spacers or
Equal to be Provided**

Side View



End View

Village of Burr Ridge
Engineering Department
451 Commerce St.
Burr Ridge, IL 60527

Address

Date
6-8-2008