


Project Name

Type A Inlet

General Notes

1. PROVIDE SELECT GRANULAR BACKFILL CA-6 TO SUBGRADE WHEN IN PAVED AREAS.
2. ALL INTERIOR JOINTS SHALL BE DRESSED WITH NON-SHRINK MORTAR.

Date	5-20-2008
Address	Village of Burr Ridge Engineering Department 451 Commerce St. Burr Ridge, IL 60527

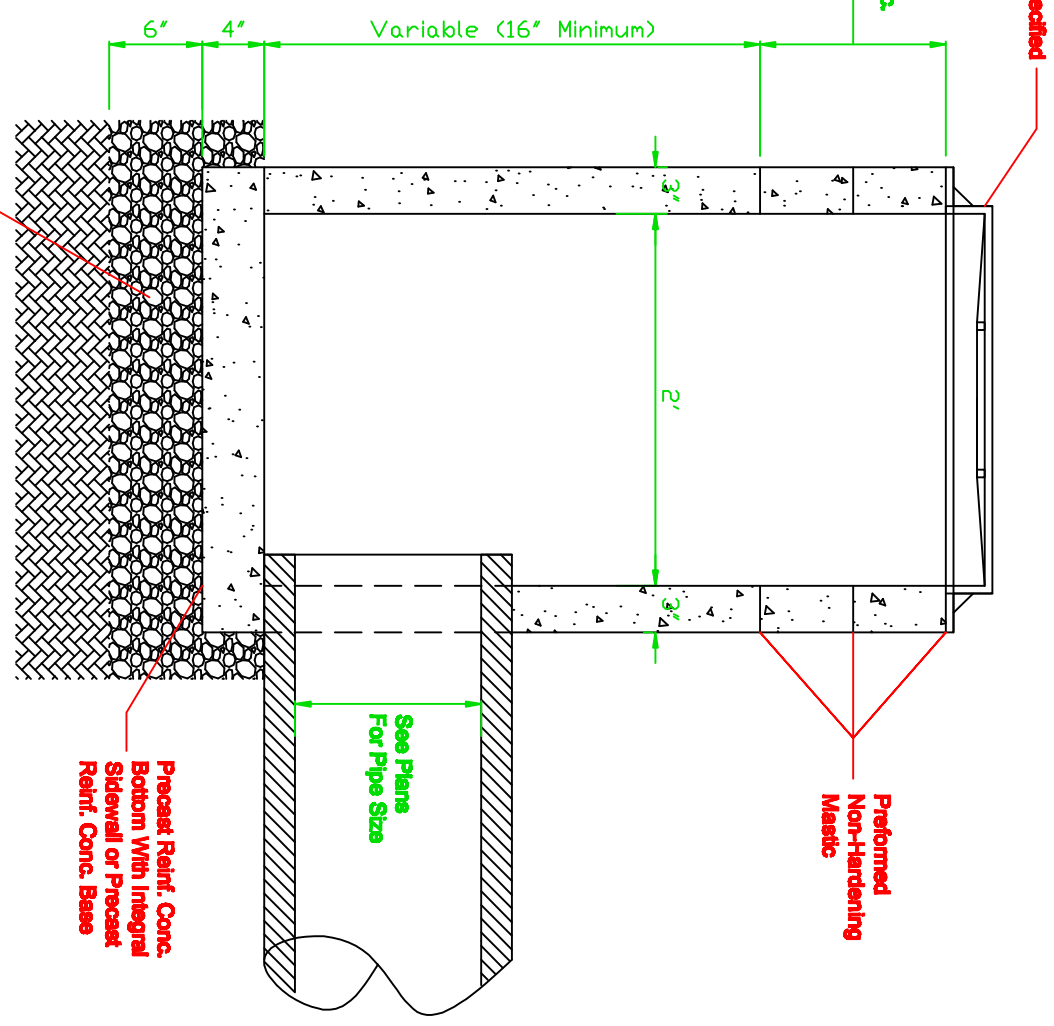

Cast as Specified

12" Max. Precast Conc. Adjusting Rings (2 Rings Max.)

Variable (16" Minimum)

6"

4"

3"

3"

2'

CA-11

Precast Reinf. Conc. Bottom With Integral Sidewall or Precast Reinf. Conc. Base

See Plans For Pipe Size

Preformed Non-Hardening Mastic