


Middlebury VT

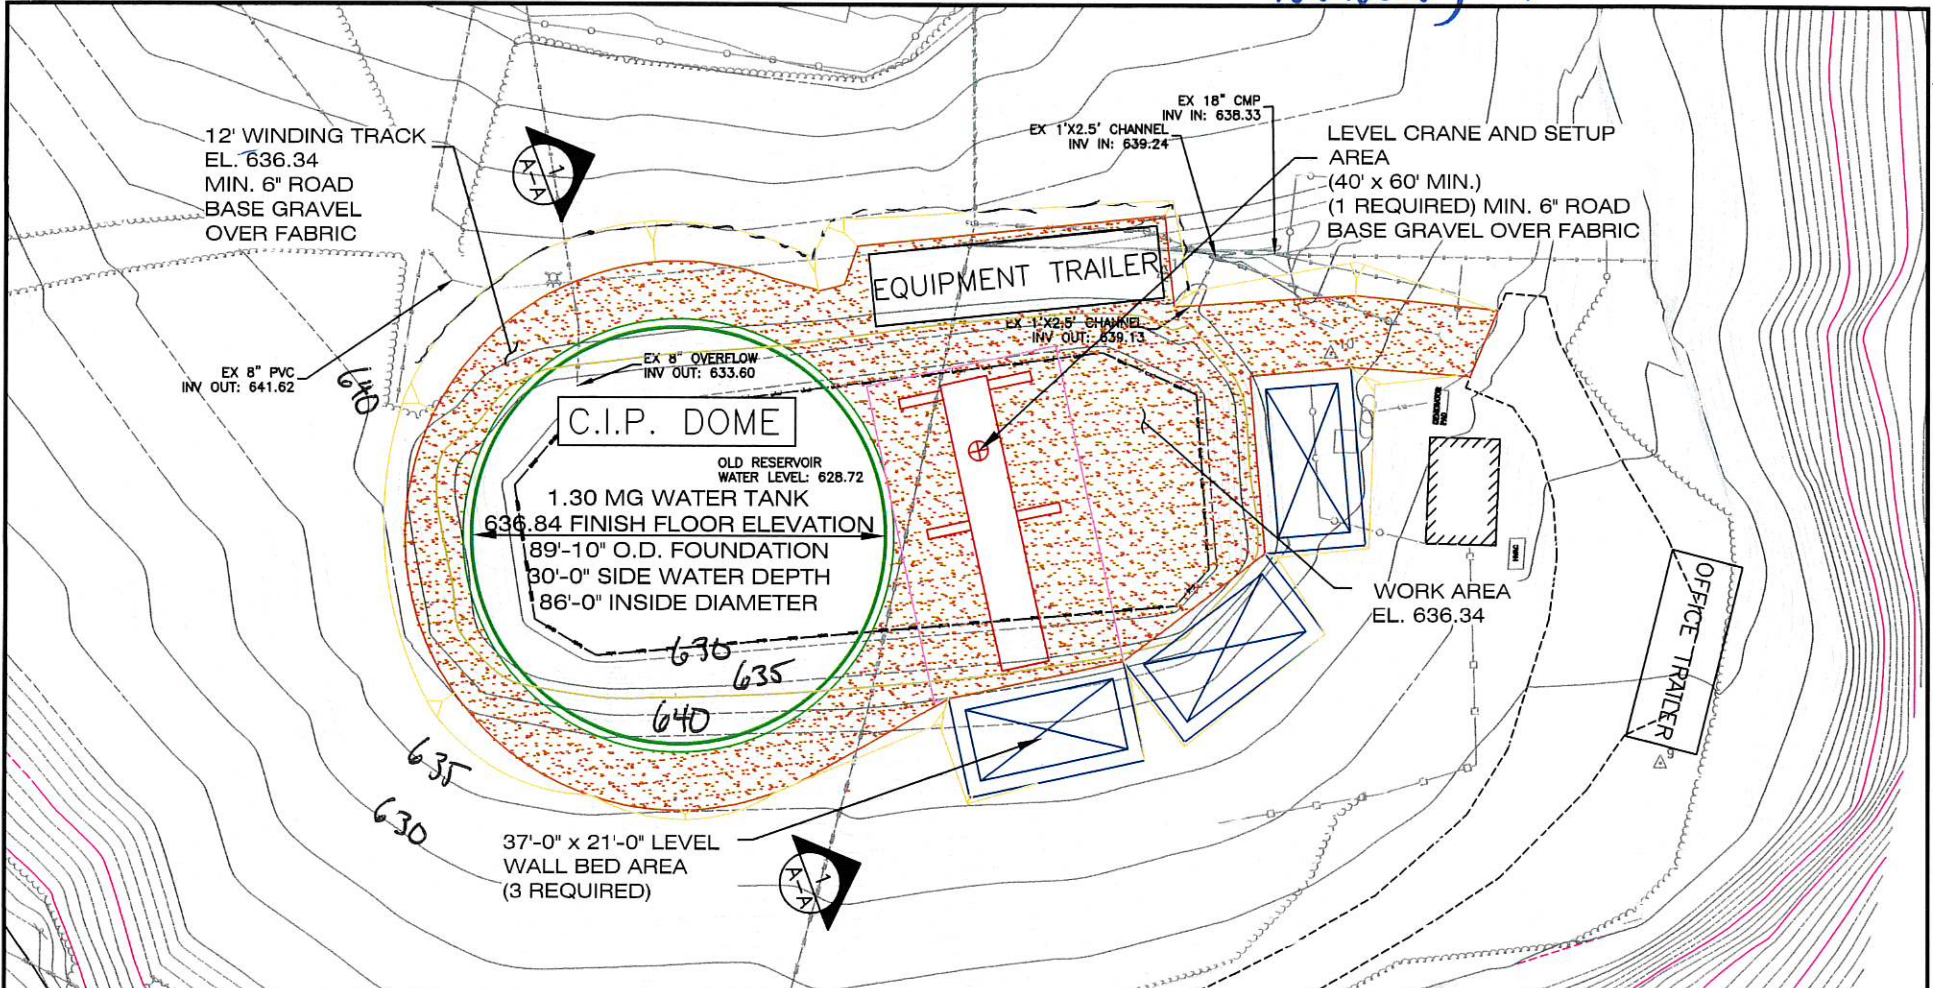

**NOTES:**

1. PLEASE USE THESE EX-DRAWINGS IN CONJUNCTION WITH THE DETAILED DN TANKS SCOPE LETTER AND SUBCONTRACT.
2. FINAL CASTING BED LOCATIONS TO BE DETERMINED BY THE DN TANKS FIELD SUPERINTENDENT.
3. LEVEL AREAS MUST BE PROVIDED FOR CASTING BEDS, CRANE AREAS, AND EQUIPMENT AND OFFICE TRAILERS. ALSO PROVIDE RAMP ACCESS TO WINDING TRACK.
4. BASED ON 330 TON CRANE WITH A 110 FT WORKING RADIUS ERECTING 15 FT WIDE & 5.00 IN UNIFORMLY THICK WALL PANELS.
5. AT A MINIMUM, ALL WORK ROADS, ACCESS ROADS, RAMPS, CRANE AREAS, AND THE WINDING TRACK SHALL HAVE 6" OF ROAD BASE OVER GEOTEXTILE FILTER FABRIC, MIRAFI 500X OR EQUAL. REFER TO SCOPE LETTER FOR REQUIREMENTS.
6. DN TANKS WILL REQUIRE A 60 FT X 15 FT AND A 40 FT X 15 FT AREA TO BE PREPARED FOR OUR EQUIPMENT TRAILER AND OFFICE TRAILER. THIS AREA MUST BE LOCATED WITHIN 150 FT OF THE TANK. THIS AREA MUST BE CLEARED, GRUBBED, LEVELED, AND EASILY ACCESSIBLE.


"THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF DN TANKS, AND MAY NOT BE DUPLICATED, IN WHOLE OR IN PART, USED FOR OTHER THAN INTERNAL REVIEW PURPOSES, OR DISCLOSED TO OTHERS, WITHOUT THE PRIOR EXPRESS WRITTEN PERMISSION OF DN TANKS."



**1.3 MG PRECAST, PRESTRESSED CONCRETE WATER STORAGE TANK CONSTRUCTION SITE LAYOUT - PLAN**

DRAWN BY: JFK	DATE: 06/22/22	SCALE: 1" = 40'	DWG# EX-1	REV:
CHECKED:	FILE: U:\ENGINEER\DRAWINGS\LAYOUTS\SITE\2022\MIDDLEBURY, VT - 4-6-22.DWG			
SITE LOCATION: Middlebury, VT			SHEET 1 OF 2	



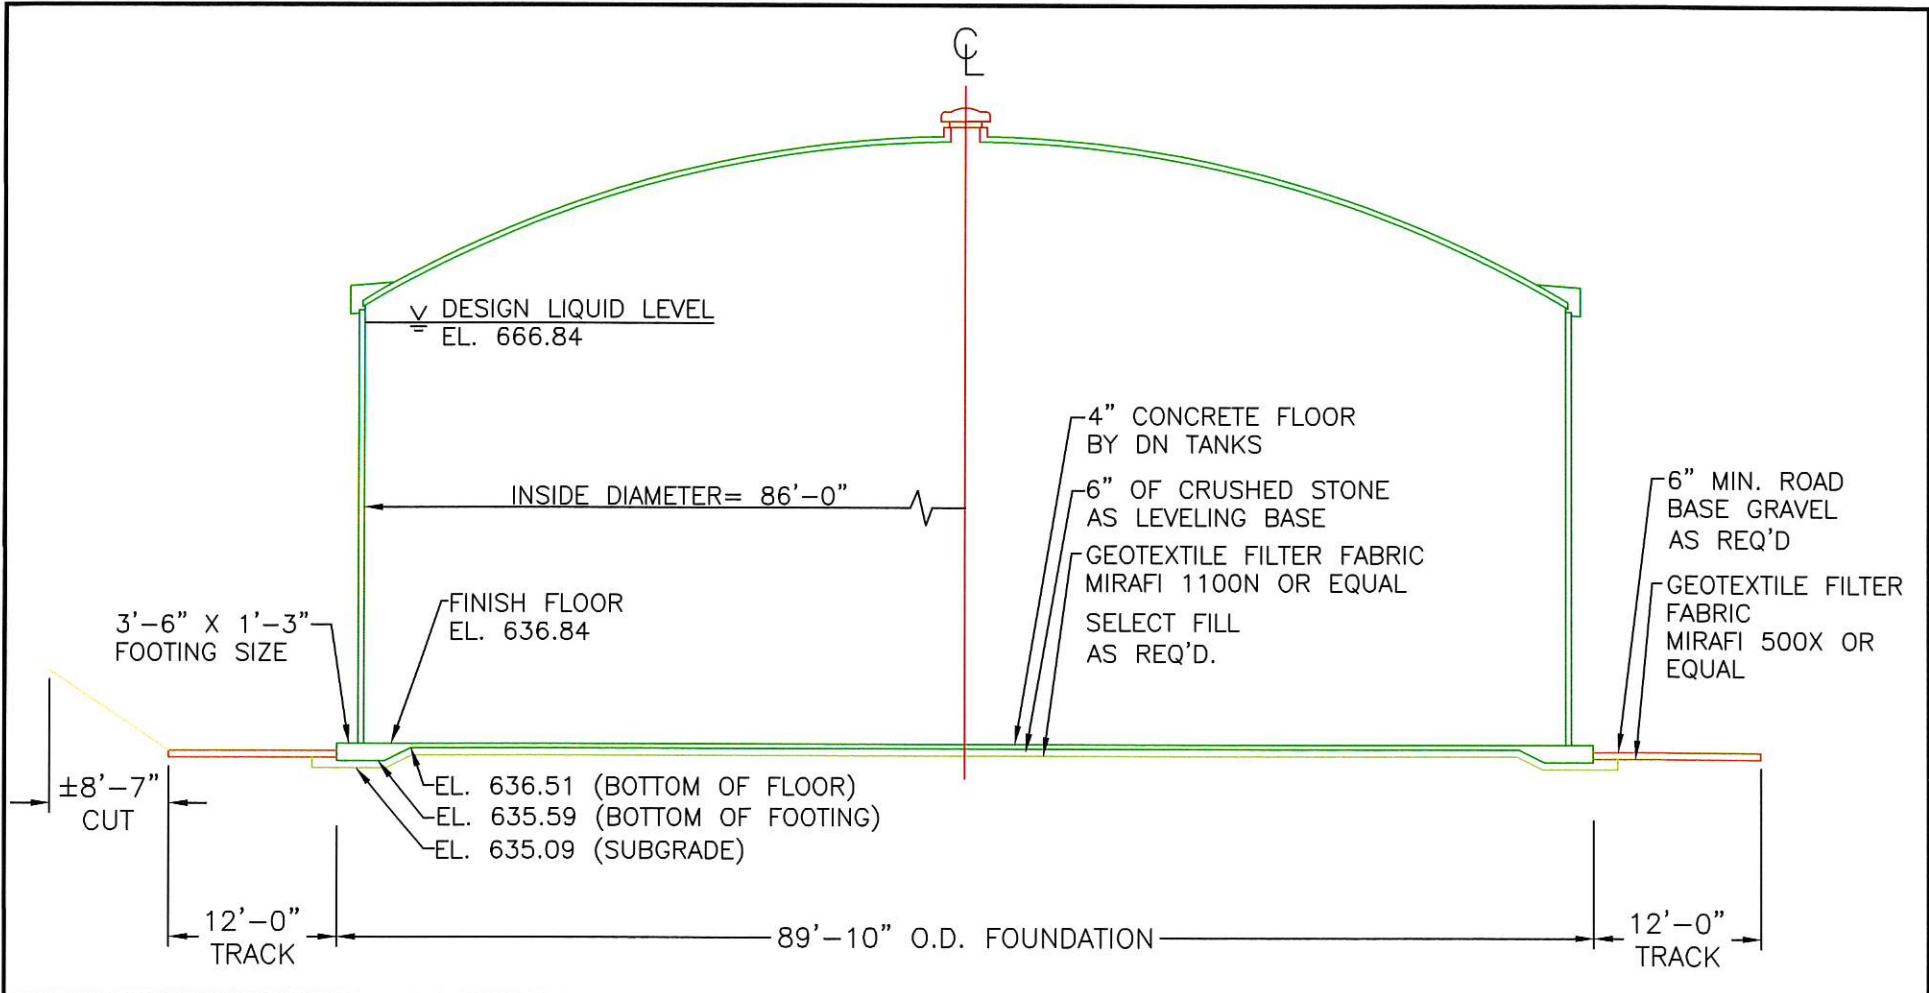

**NOTES:**

1. PLEASE USE THESE EX-DRAWINGS IN CONJUNCTION WITH THE DETAILED DN TANKS SCOPE LETTER AND SUBCONTRACT.
2. ALL TEMPORARY SLOPES ARE TO MEET OSHA REQUIREMENTS.
3. FOUNDATION PREP SHALL BE ADJUSTED IN ACCORDANCE WITH THE FINAL GEOTECHNICAL REPORT.
4. AT A MINIMUM, ALL WORK ROADS, ACCESS ROADS, RAMPS, CRANE AREAS, AND THE WINDING TRACK SHALL HAVE 6" OF ROAD BASE OVER GEOTEXTILE FILTER FABRIC, MIRAFI 500X OR EQUAL. REFER TO SCOPE LETTER FOR REQUIREMENTS.
5. DN TANKS WILL REQUIRE A 60 FT X 15 FT AND A 40 FT X 15 FT AREA TO BE PREPARED FOR OUR EQUIPMENT TRAILER AND OFFICE TRAILER. THIS AREA MUST BE LOCATED WITHIN 150 FT OF THE TANK. THIS AREA MUST BE CLEARED, GRUBBED, LEVELED, AND EASILY ACCESSIBLE.

SECTION

1  
A-A

"THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF DN TANKS, AND MAY NOT BE DUPLICATED, IN WHOLE OR IN PART, USED FOR OTHER THAN INTERNAL REVIEW PURPOSES, OR DISCLOSED TO OTHERS, WITHOUT THE PRIOR EXPRESS WRITTEN PERMISSION OF DN TANKS."



**1.30 MG PRECAST, PRESTRESSED  
CONCRETE WATER STORAGE TANK  
CONSTRUCTION SITE LAYOUT - SECTION**

DRAWN BY: JFK	DATE: 06/22/22	SCALE: NTS	DWG# EX-2	REV:
CHECKED:	FILE: U:\ENGINEER\DRAWINGS\LAYOUTS\SITE\2022\MIDDLEBURY, VT - 4-6-22.DWG			
SITE LOCATION: Middlebury, VT				SHEET 2 OF 2