


Temporary Overhead Service

RESIDENTIAL

The path to the Service Pole shall be Clear of Trees and Building debris & materials.

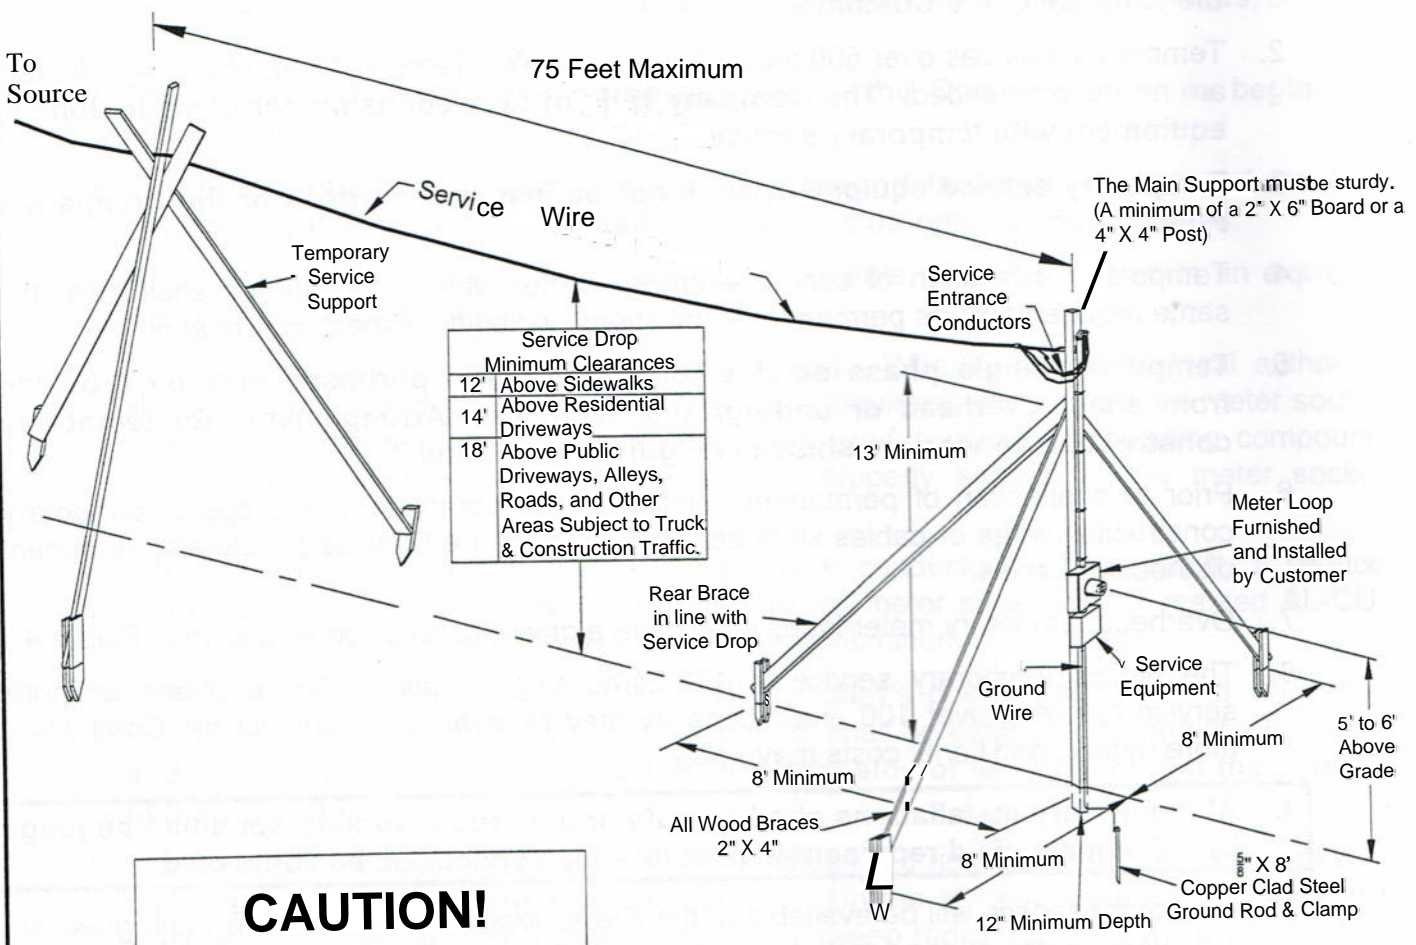

Service Drop Minimum Clearances	
12'	Above Sidewalks
14'	Above Residential Driveways
18'	Above Public Driveways, Alleys, Roads, and Other Areas Subject to Truck & Construction Traffic.

CAUTION!
Contact All Utilities Before Digging, Staking or Driving a Ground Rod.

Refer to NEC for Ground Fault Circuit Interrupter Requirements

Service Size	Minimum wire size copper	
	Neutral*	Line
100 Amp	#3	#3

All Services Shall Have Full Neutrals

Service Size	Minimum ground wire size copper
100 Amp	#6

All Equipment Furnished and Installed By Customer Unless Otherwise Noted

Definitions and Clearances on reverse

City of Monett

Pride and Progress

Building Inspector 417-235-5306
Electric Foreman 417-737-0242
City of Monett
217 5TH Street
Monett Mo. 65708