


MAXIMUM HOLE SIZE:

D1'	BEARING	NON-BEARING
2x4	1 3/8"	2 1/8"
2x6	2 1/4"	3 1/4"
2x8	2 7/8"	4 3/8"
2x10	3 5/8"	5 1/2"


- NOTES:**
1. PREDRILL CORNERS OF NOTCHES SO AS NOT TO OVER CUT.
 2. NOTCHES ON THE ENDS OF JOISTS AND HEADERS SHALL NOT EXCEED 1/4 OF THE JOIST DEPTH.
 3. NOTCHES IN THE BOTTOM OF JOISTS ALLOWED ONLY WHERE SPECIFICALLY SHOWN ON THE DRAWINGS.
 4. NOTCHES IN THE TOP OF JOISTS SHALL NOT EXCEED 1/16 OF THE DEPTH AND SHALL NOT BE LOCATED IN THE MIDDLE 1/3 OF THE SPAN.
 5. HOLES BORED IN THE JOIST SHALL NOT BE WITHIN 2 INCHES OF THE TOP OR BOTTOM AND SHALL NOT HAVE A DIAMETER LARGER THAN 1/4 OF THE DEPTH OF THE JOIST.

HOLES & NOTCH
NO SCALE

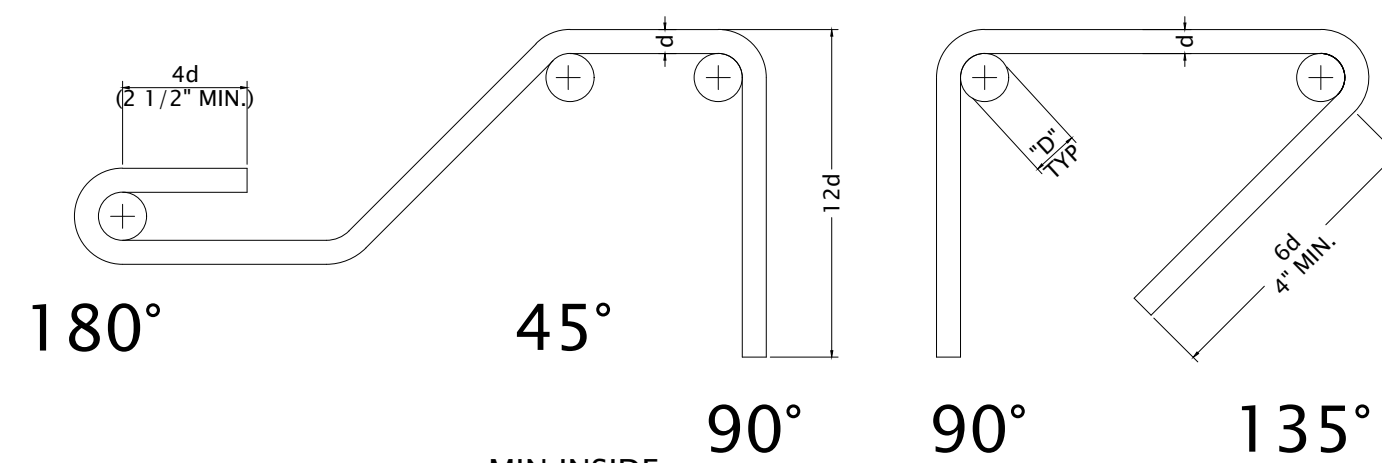

MIN INSIDE BAR SIZE BEND ~ "D"		MIN INSIDE BAR SIZE BEND ~ "D"	
#3 - #8	6d	#3 - #5	4d
#9 - #11	8d	#6 - #8	6d
#14 & #18	10d		


TYPICAL STIRRUPS AND TIES

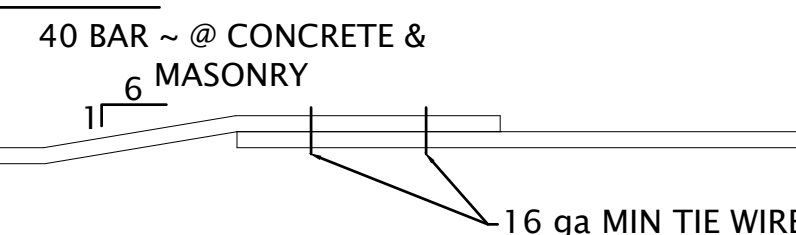


TYP. RE-BAR HOOKS & BENDS
NO SCALE

NOTE:
VERIFY ALL REBAR IN FOOTINGS WITH THE FOUNDATION PLAN


NOTE:
ALL SILL PLATES FOR SHEAR WALLS IN CONTACT WITH CONCRETE SHALL BE DOUGLAS FIR PRESSURE TREATED LUMBER.

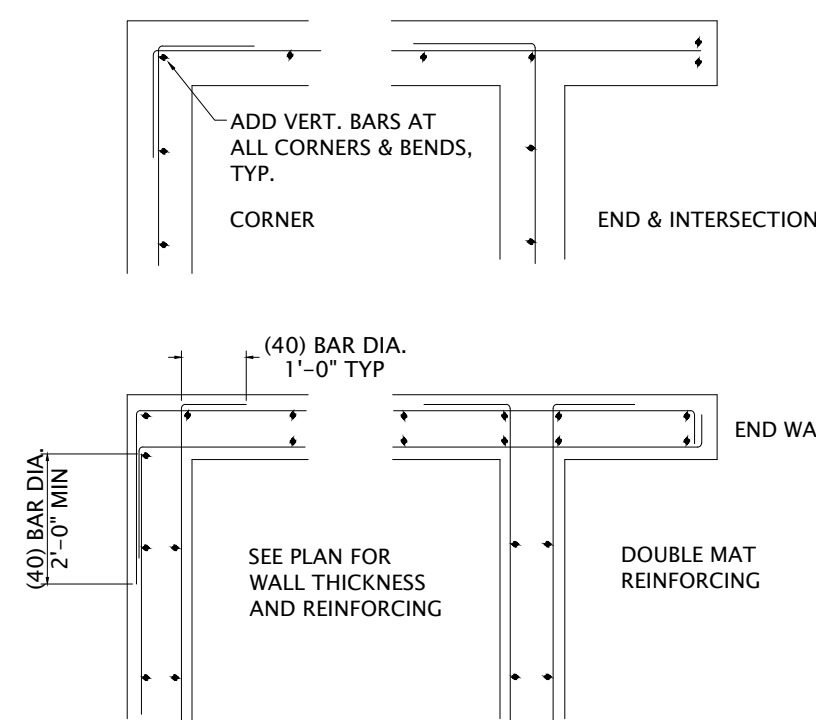


TYP. HORIZ. FOOTING REINF.
NO SCALE

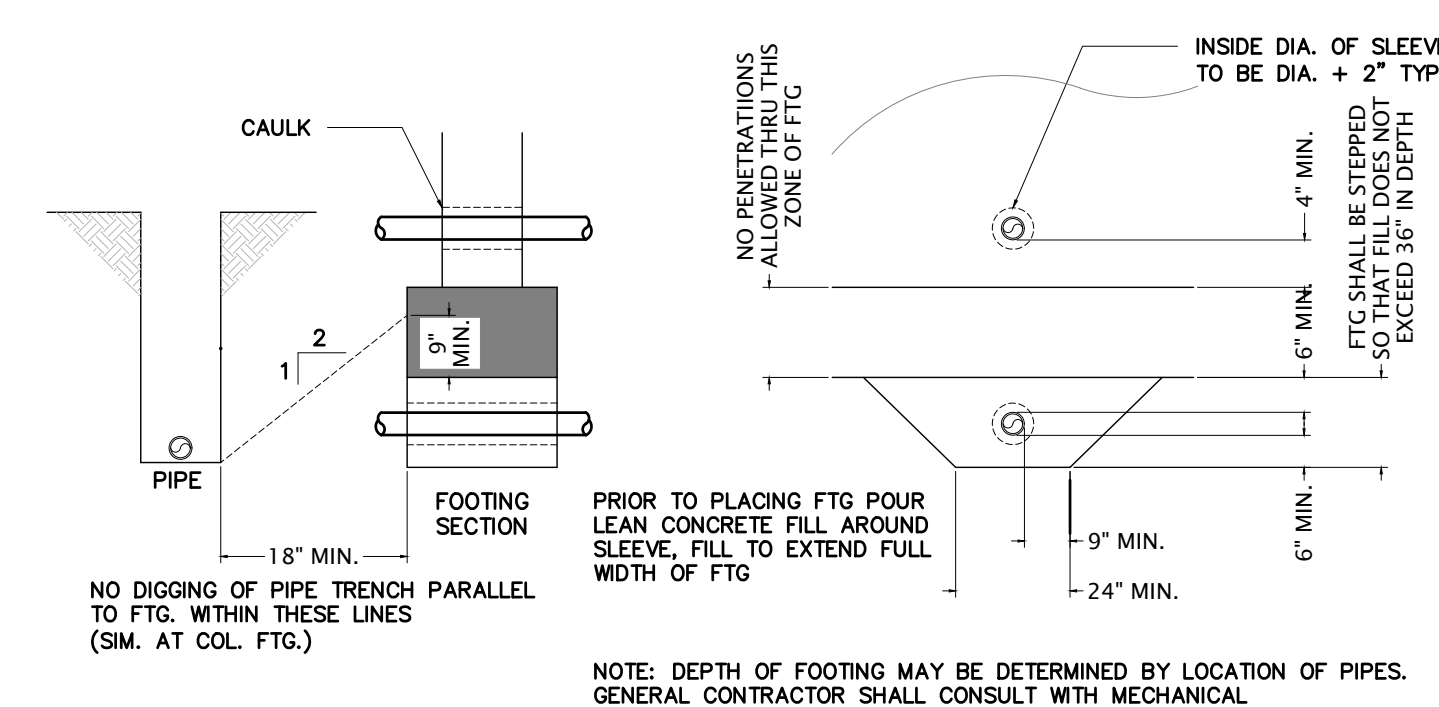


TYP. PIPE THRU FOOTING
NO SCALE

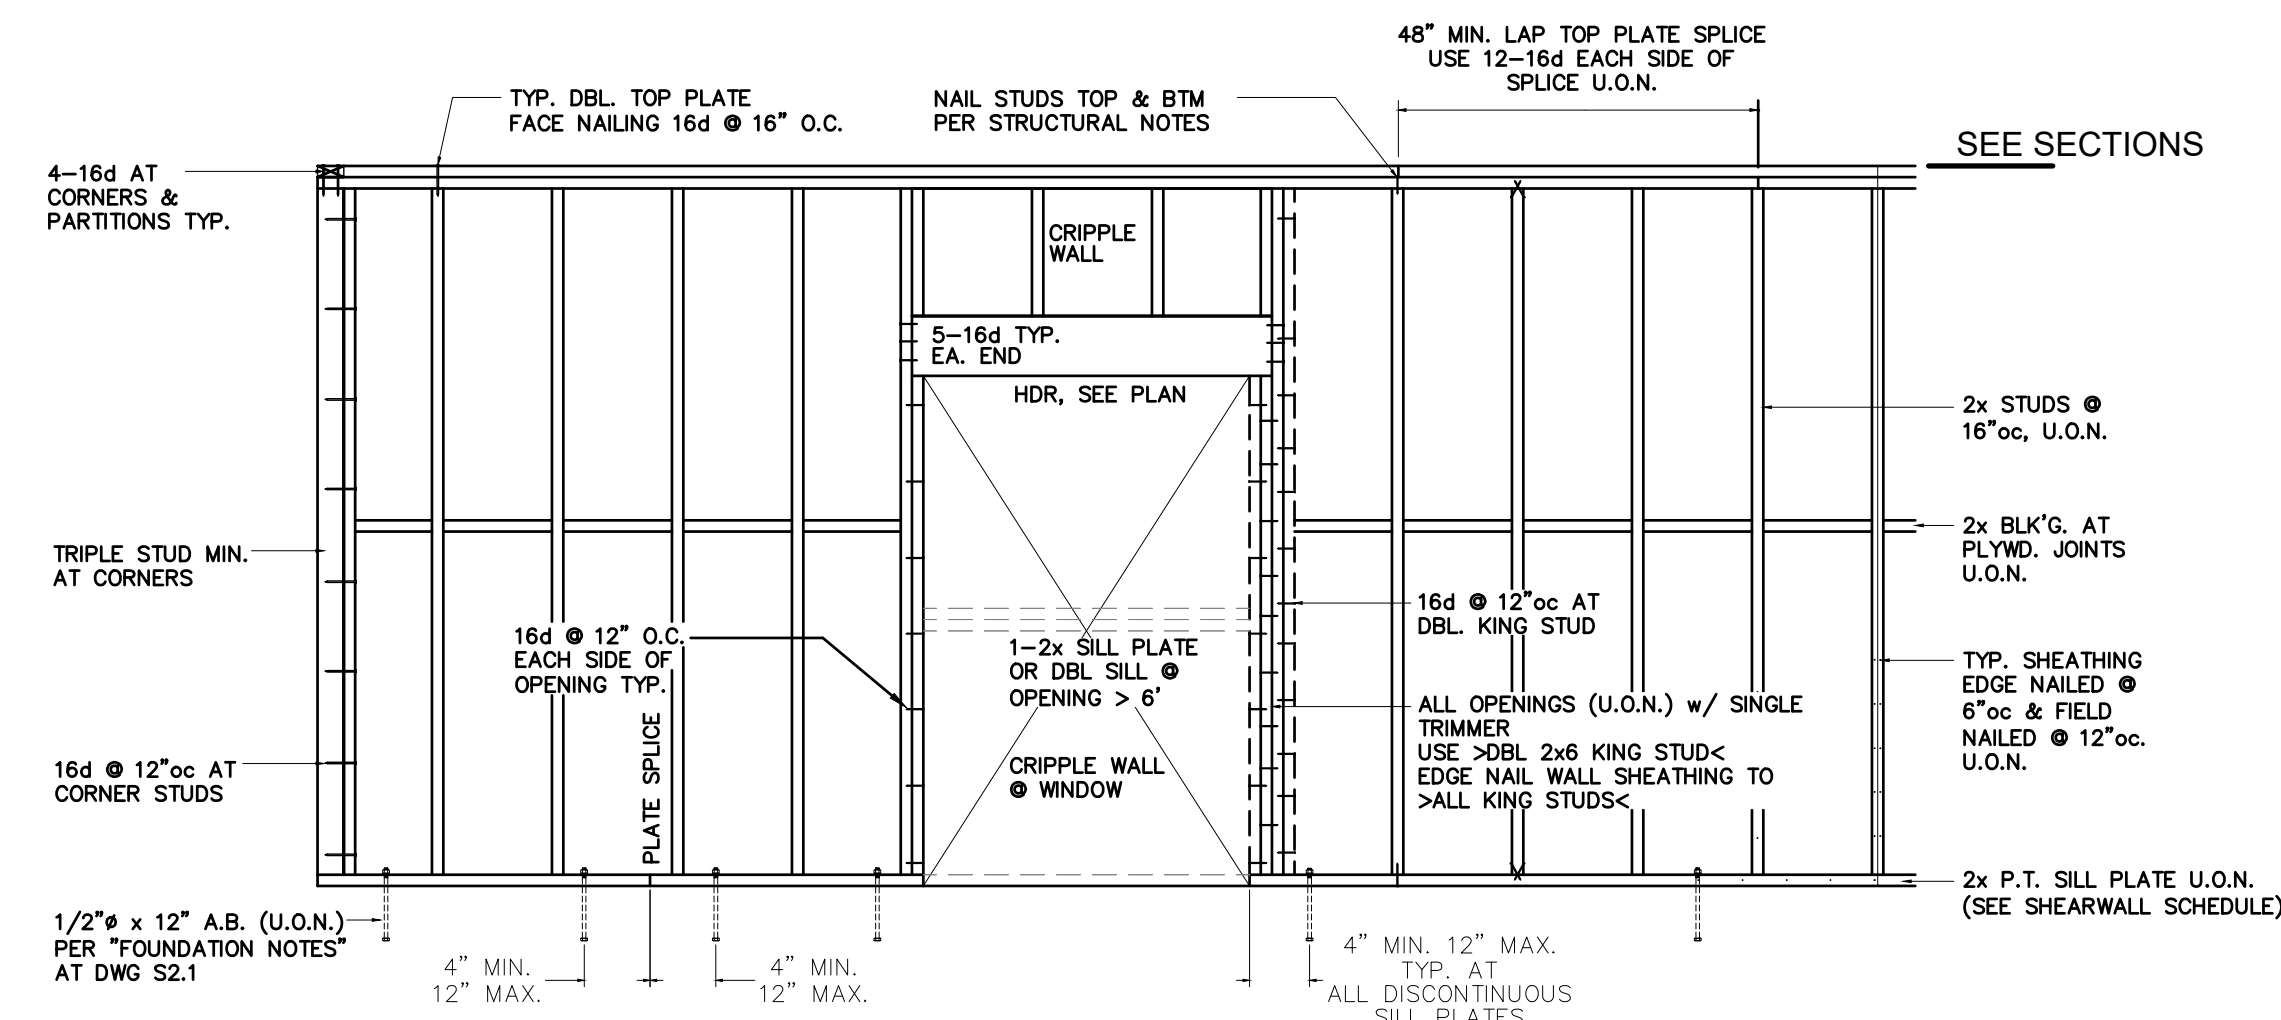


TYP. BEARING WALL DETAILS
NO SCALE

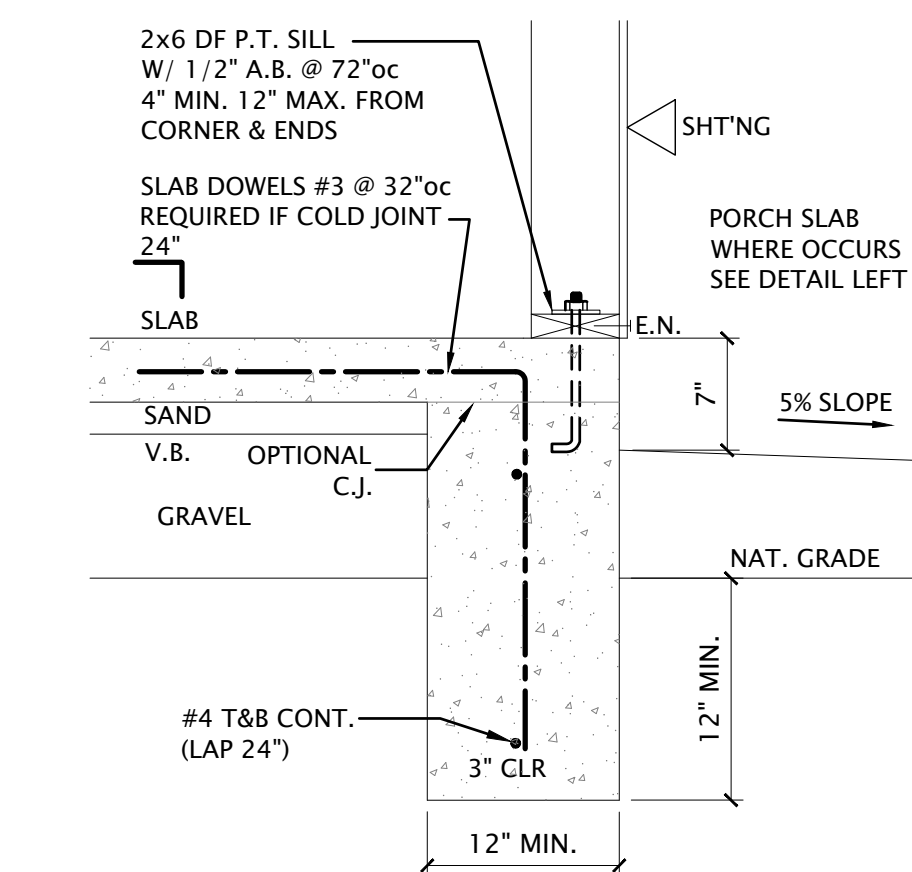

PERIMETER FOOTING
SCALE: 1"=1'-0"

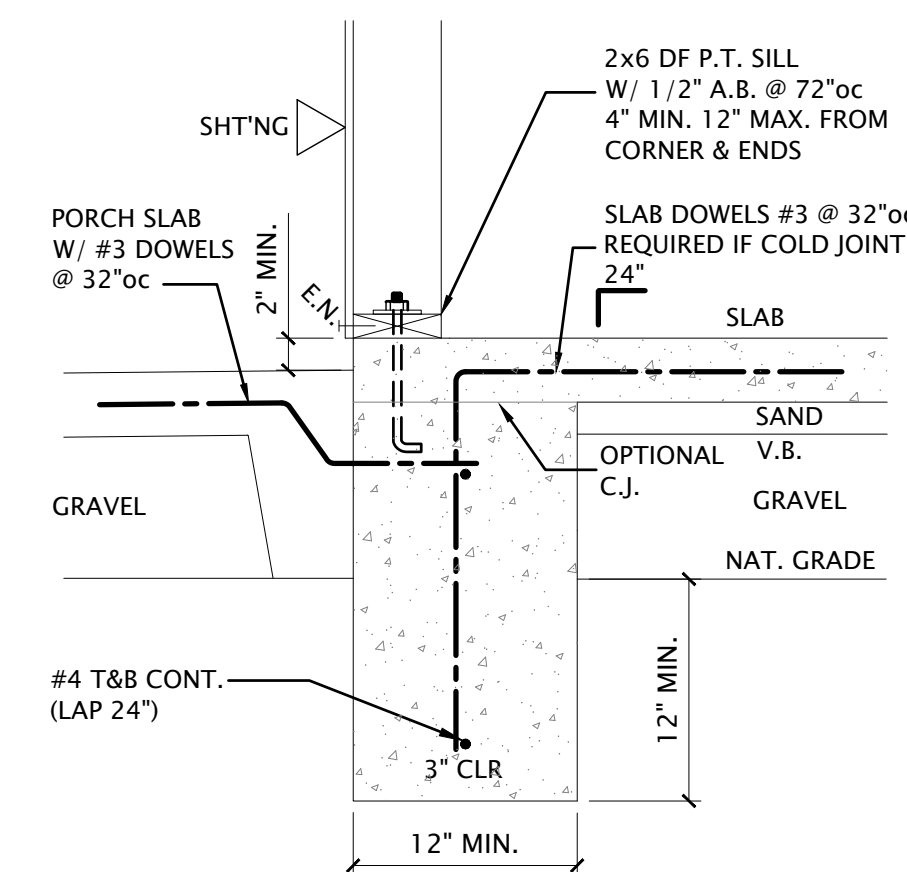

FOOTING
SCALE: 1"=1'-0"

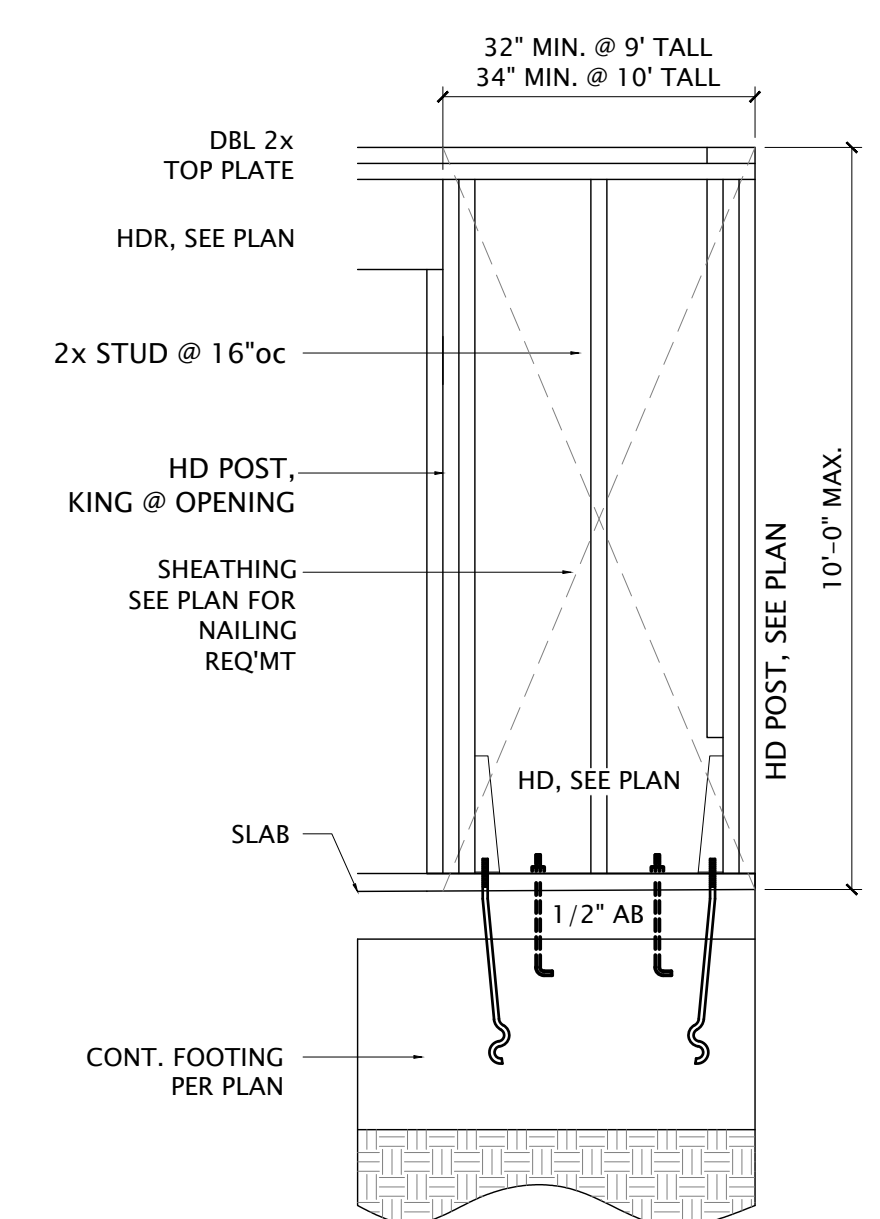

ALTERNATE BRACE WALL
NO SCALE

REVISIONS

DATE	DESCRIPTION
08/22/2022	ISSUED FOR PERMIT

DATE: 08/22/2022
JOB NUMBER: _____
CADD FILE: _____
SEAL: _____

ANTONETTE GROSSMAN
C-35355
RENEWAL: 2/28/23
STATE OF CALIFORNIA
08/22/2022


STRUCTURAL DETAILS
SMALL ACCESSORY DWELLING UNIT - (461 SQ FT ONE BEDROOM)

CITY OF RED BLUFF
555 WASHINGTON
RED BLUFF, CA 96080
APR.


CMC
ARCHITECTURE | CMCARK.COM

CMC ARCHITECTURE
3301 BIRCH CREEK DRIVE I
RED BLUFF, CA 96080
(530) 440-9256


SHEET
S3.1
PERMIT SET

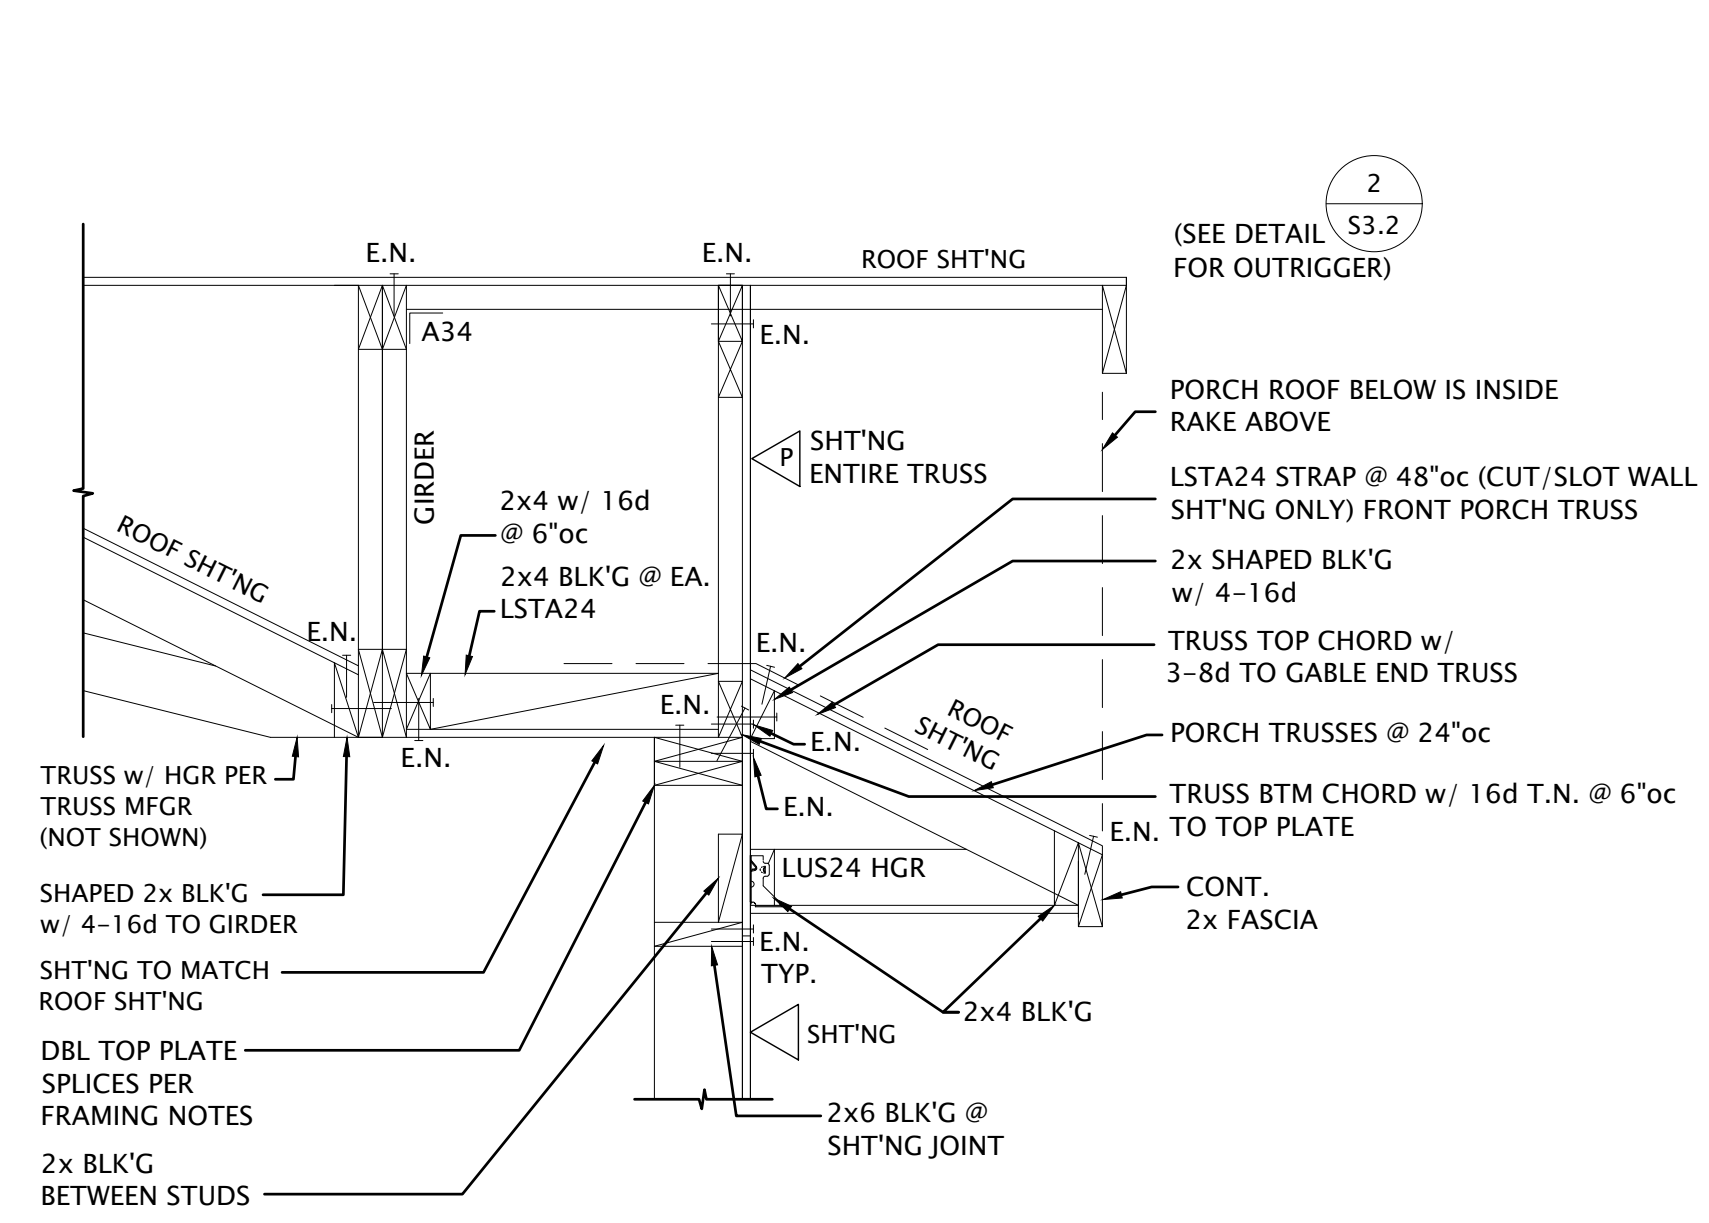


1 GABLE END / DUTCH

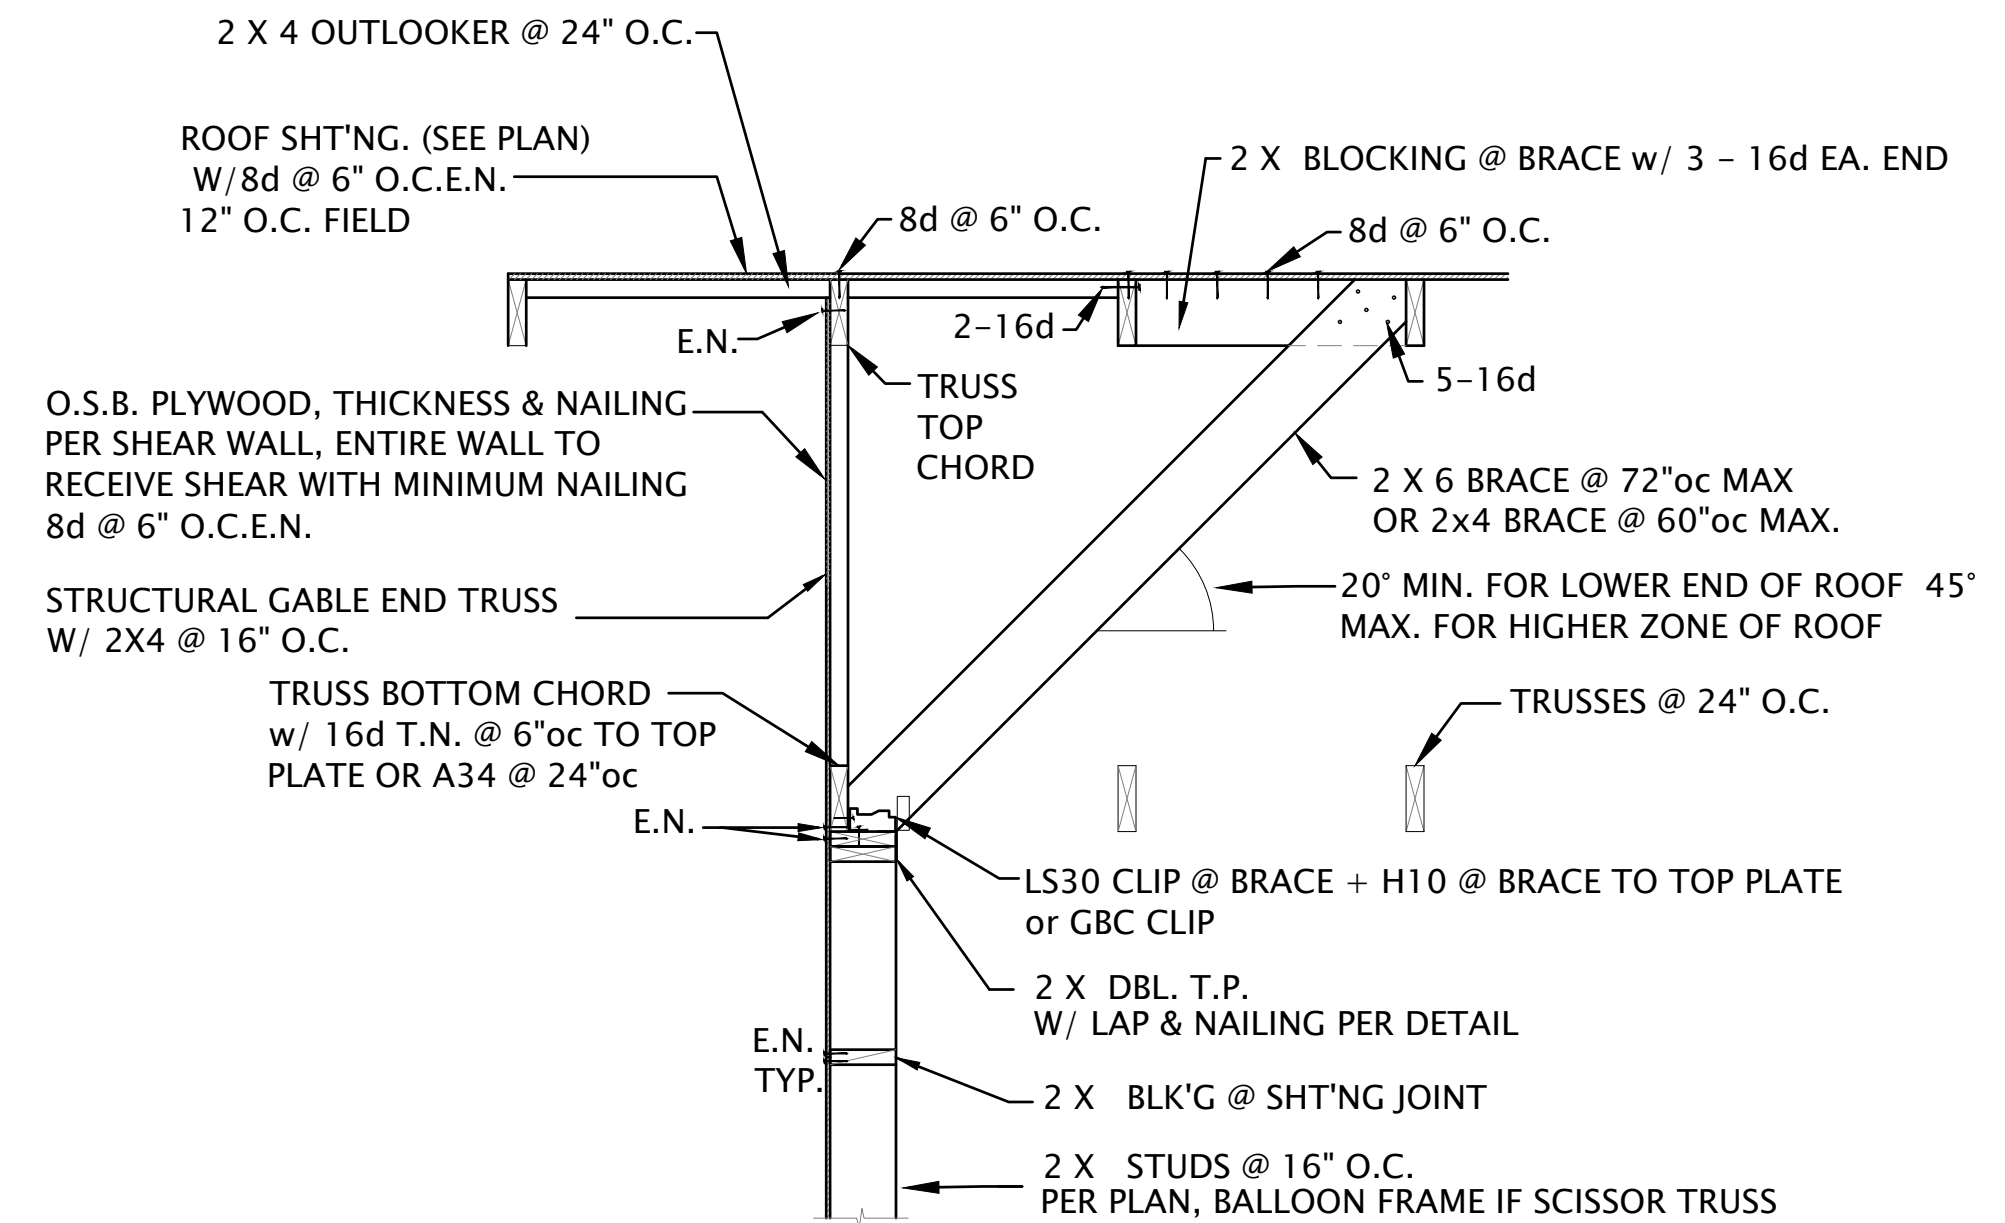


2 TYP. GABLE END SHEAR TRANSFER

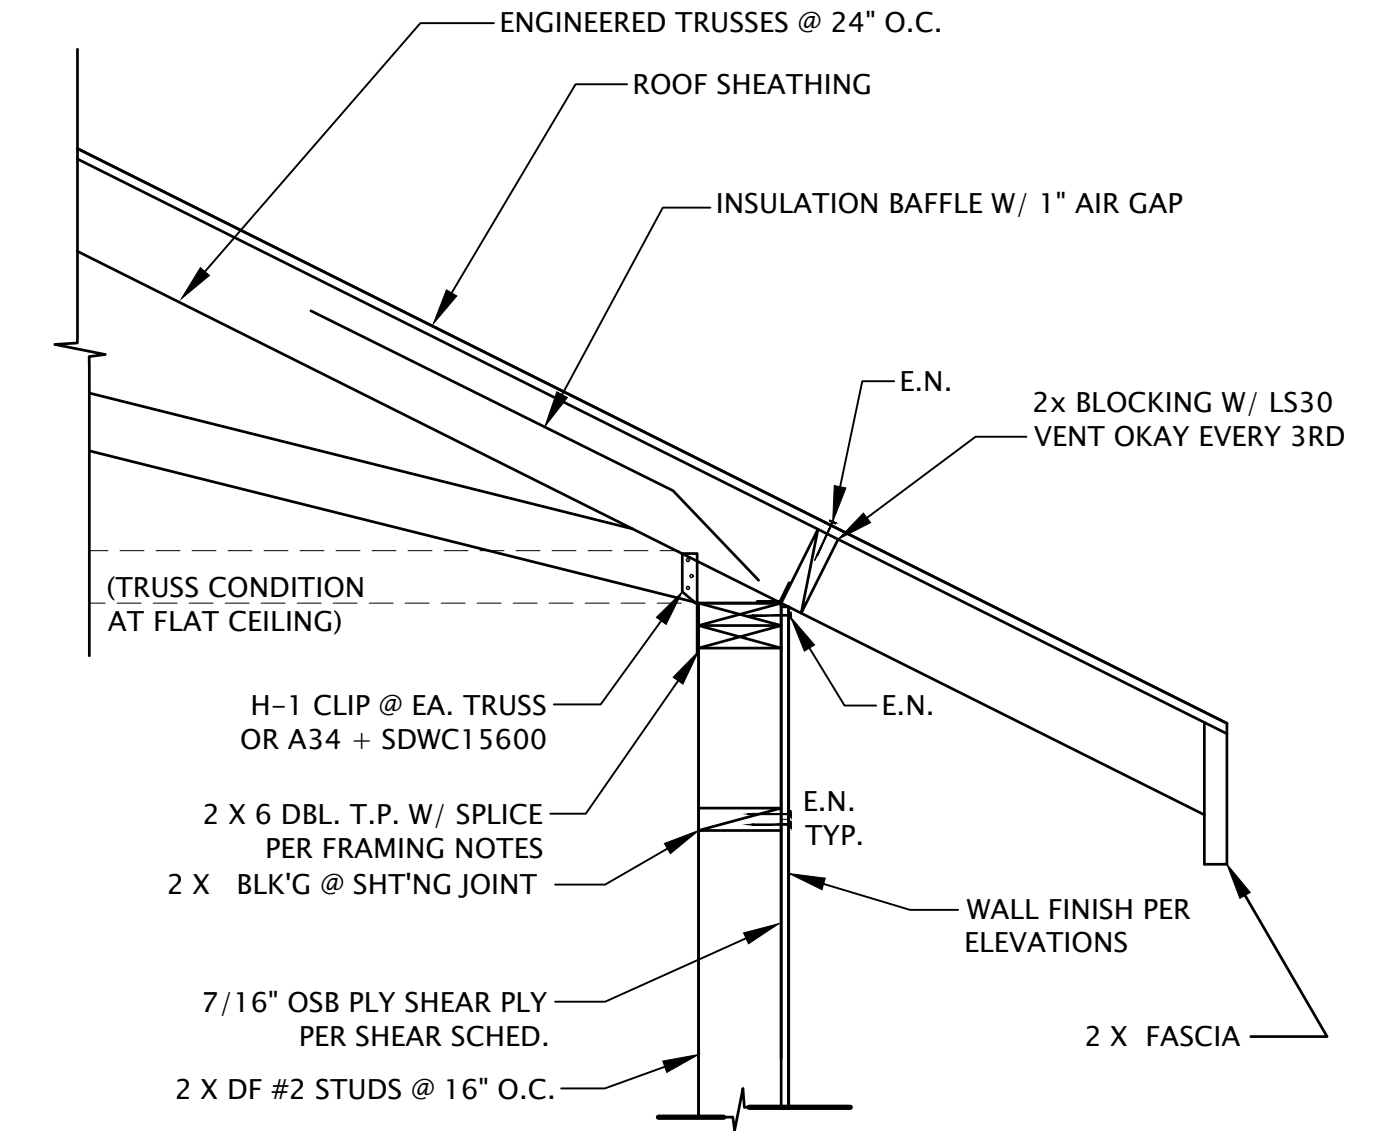


3 TYPICAL LOW EAVE DETAIL

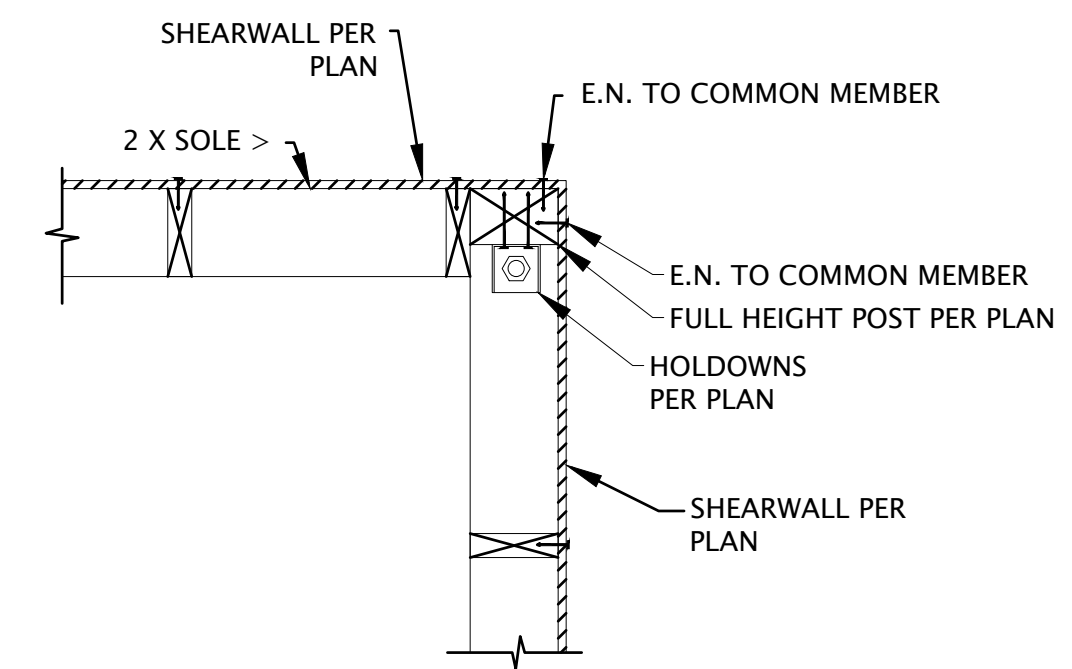


FRAMING @ CORNER W/ HOLD DOWN CASE 1

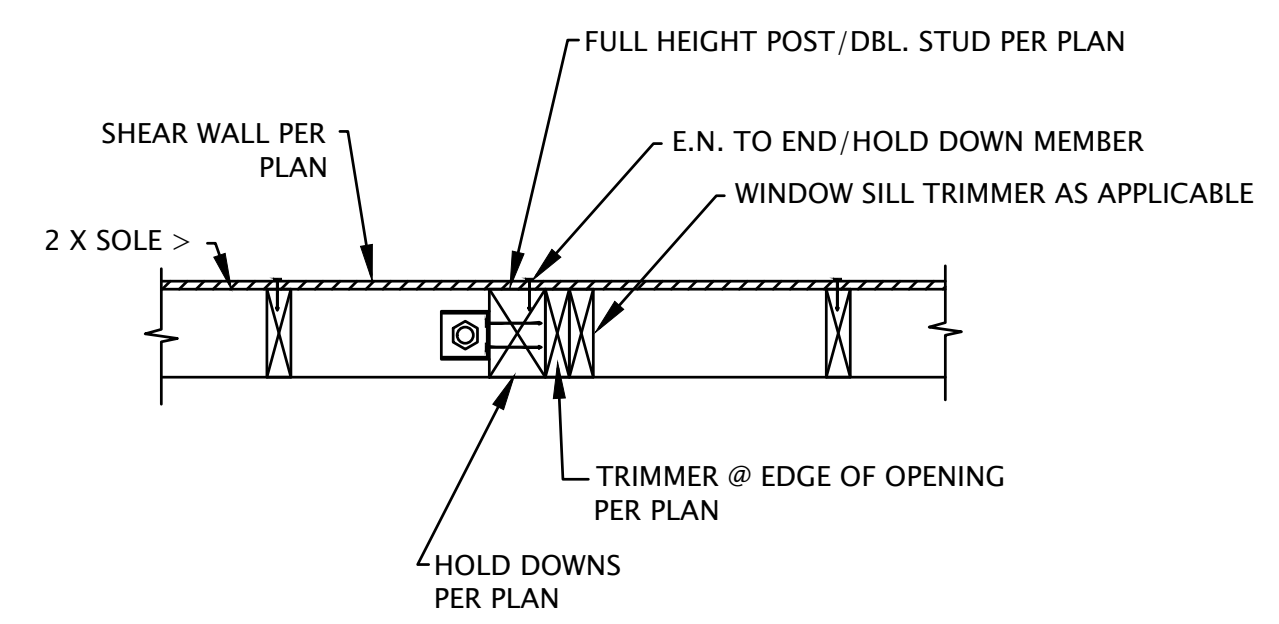


FRAMING @ INTERIOR W/ HOLD DOWN CASE 2

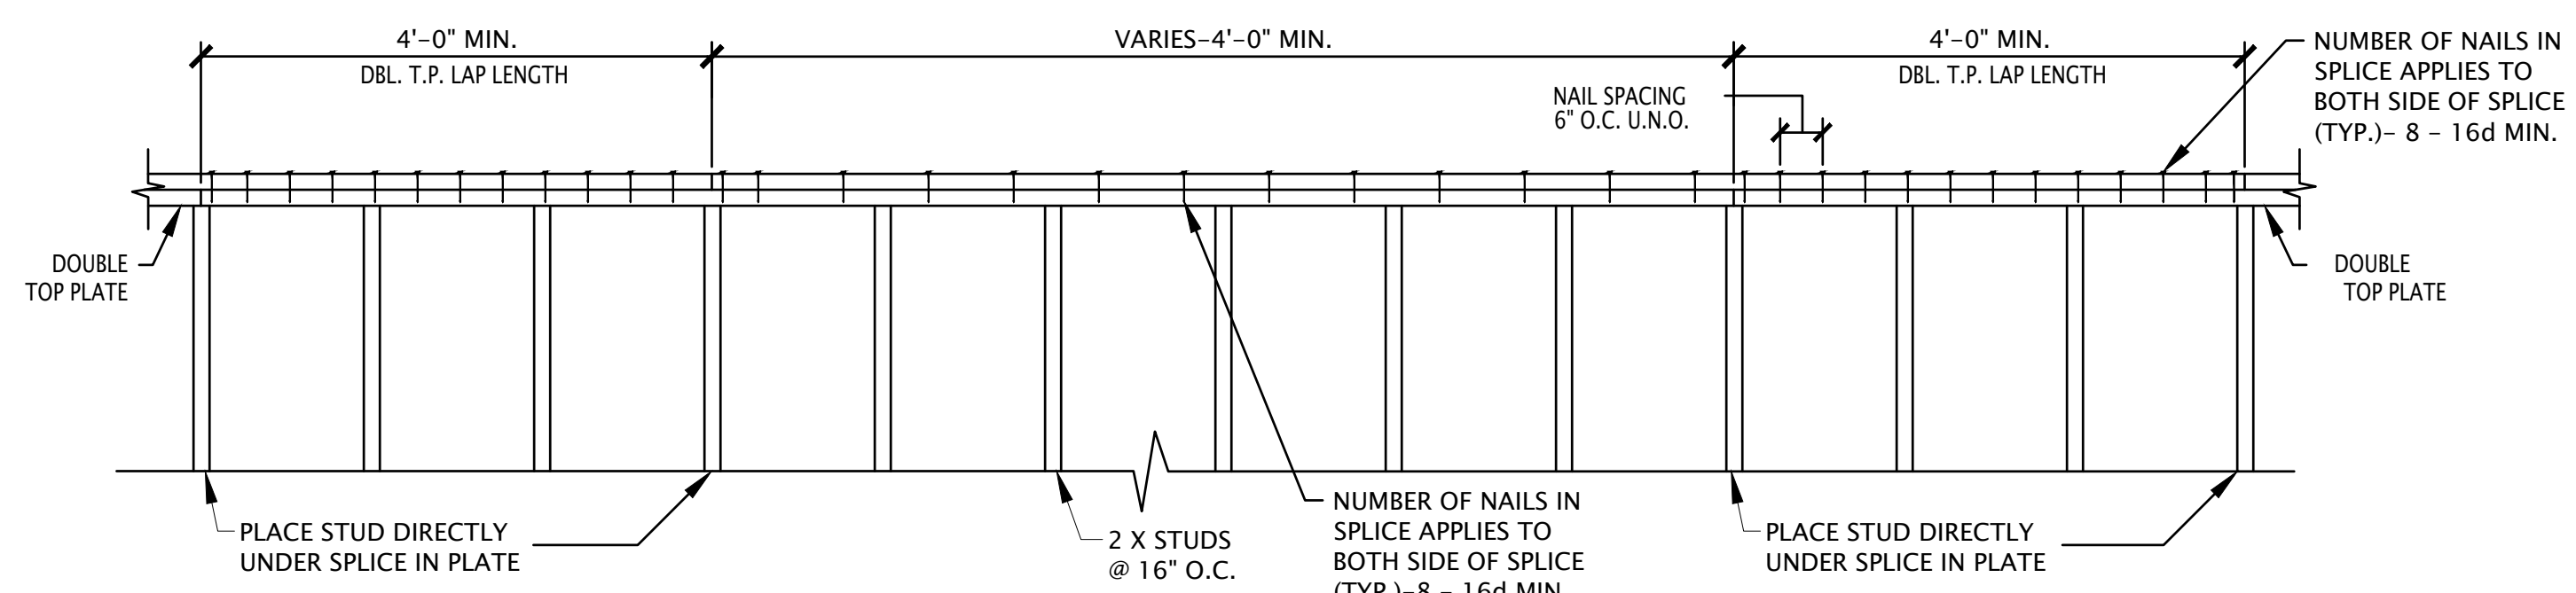


CHORD/DBL. T.P. LAP SPLICE
(TYPICAL THRU-OUT PLAN U.N.O. PER SCHEDULE)

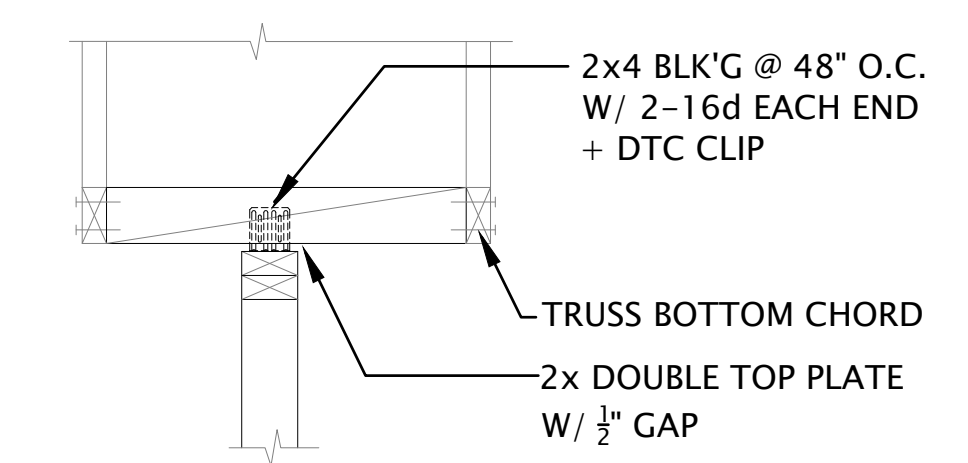

NON-BEARING TOP OF WALL
WALL PARALLEL TO TRUSS

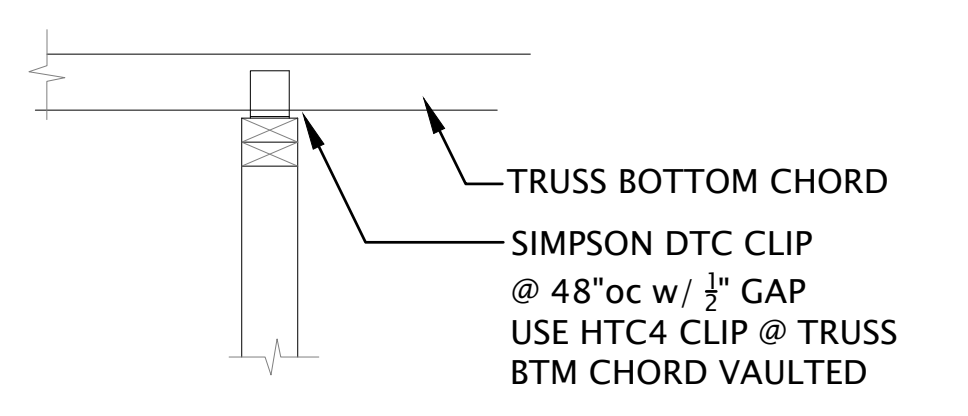

NON-BEARING TOP OF WALL
WALL PERPENDICULAR TO TRUSS

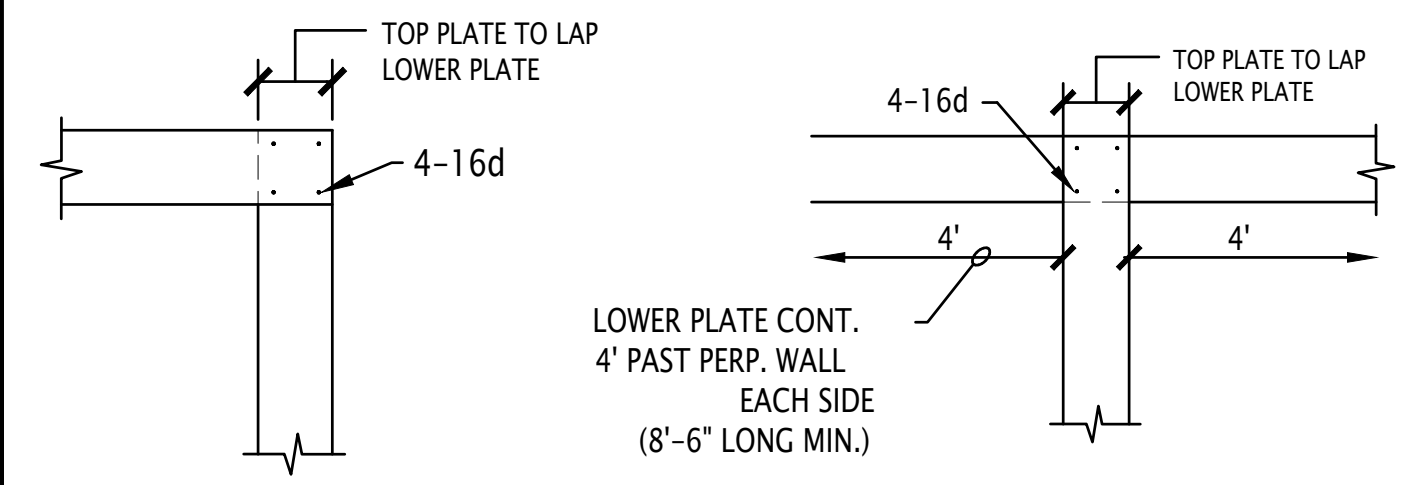

TYPICAL CORNER TYPICAL INTERSECTION
TOP PLATE TIES

- NOTES:
- 1) INSTALL TRUSSES, WEB & LATERAL BRACING IN STRICT ACCORDANCE WITH THE TRUSS MANUFACTURER SPECIFICATIONS, INCLUDING ALL REQUIRED HANGERS.
 - 2) ALL EXTERIOR HEADERS SHALL BE 6 X 12 DF #2 U.N.O.
 - 3) ALL FASTENERS FOR THE ROOFING SHALL PENETRATE THROUGH THE ROOF SHEATHING.

REVISIONS

DATE: 08/22/2022
JOB NUMBER: 190345-0001
CADD FILE: 190345-0001-0001.rvt

SEAL: 08/22/2022

ANTONETTE MONTANO
REGISTERED ARCHITECT
C-35355
RENEWAL: 2/28/23
STATE OF CALIFORNIA

SHEET NAME & PROJECT
STRUCTURAL DETAILS
SMALL ACCESSORY DWELLING UNIT - (461 SQ FT ONE BEDROOM)

CITY OF RED BLUFF
555 WASHINGTON
RED BLUFF, CA 96080
APR.

CMC ARCHITECTURE
3801 THE CENTER DRIVE, SUITE 1
RED BLUFF, CA 96080
(530) 440-9256

ARCHITECTURE | CMCARK.COM

SHEET
S3.2
PERMIT SET

© COPYRIGHT 2022 - CMC ARCHITECTURE - ALL RIGHTS RESERVED